


EDI. CO. M. srl
Via Deviotoranesco n. 31/C
BARI



IMPIANTO DI RISCALDAMENTO

Scala
1:100
Data
15-3-85
Tav
1


ALLOGGI POPOLARI
FRANCAVILLA FONTANA

Comparto 8
Piano di zona 167


piante, prospetti e sezione

G

I.A.C.P.

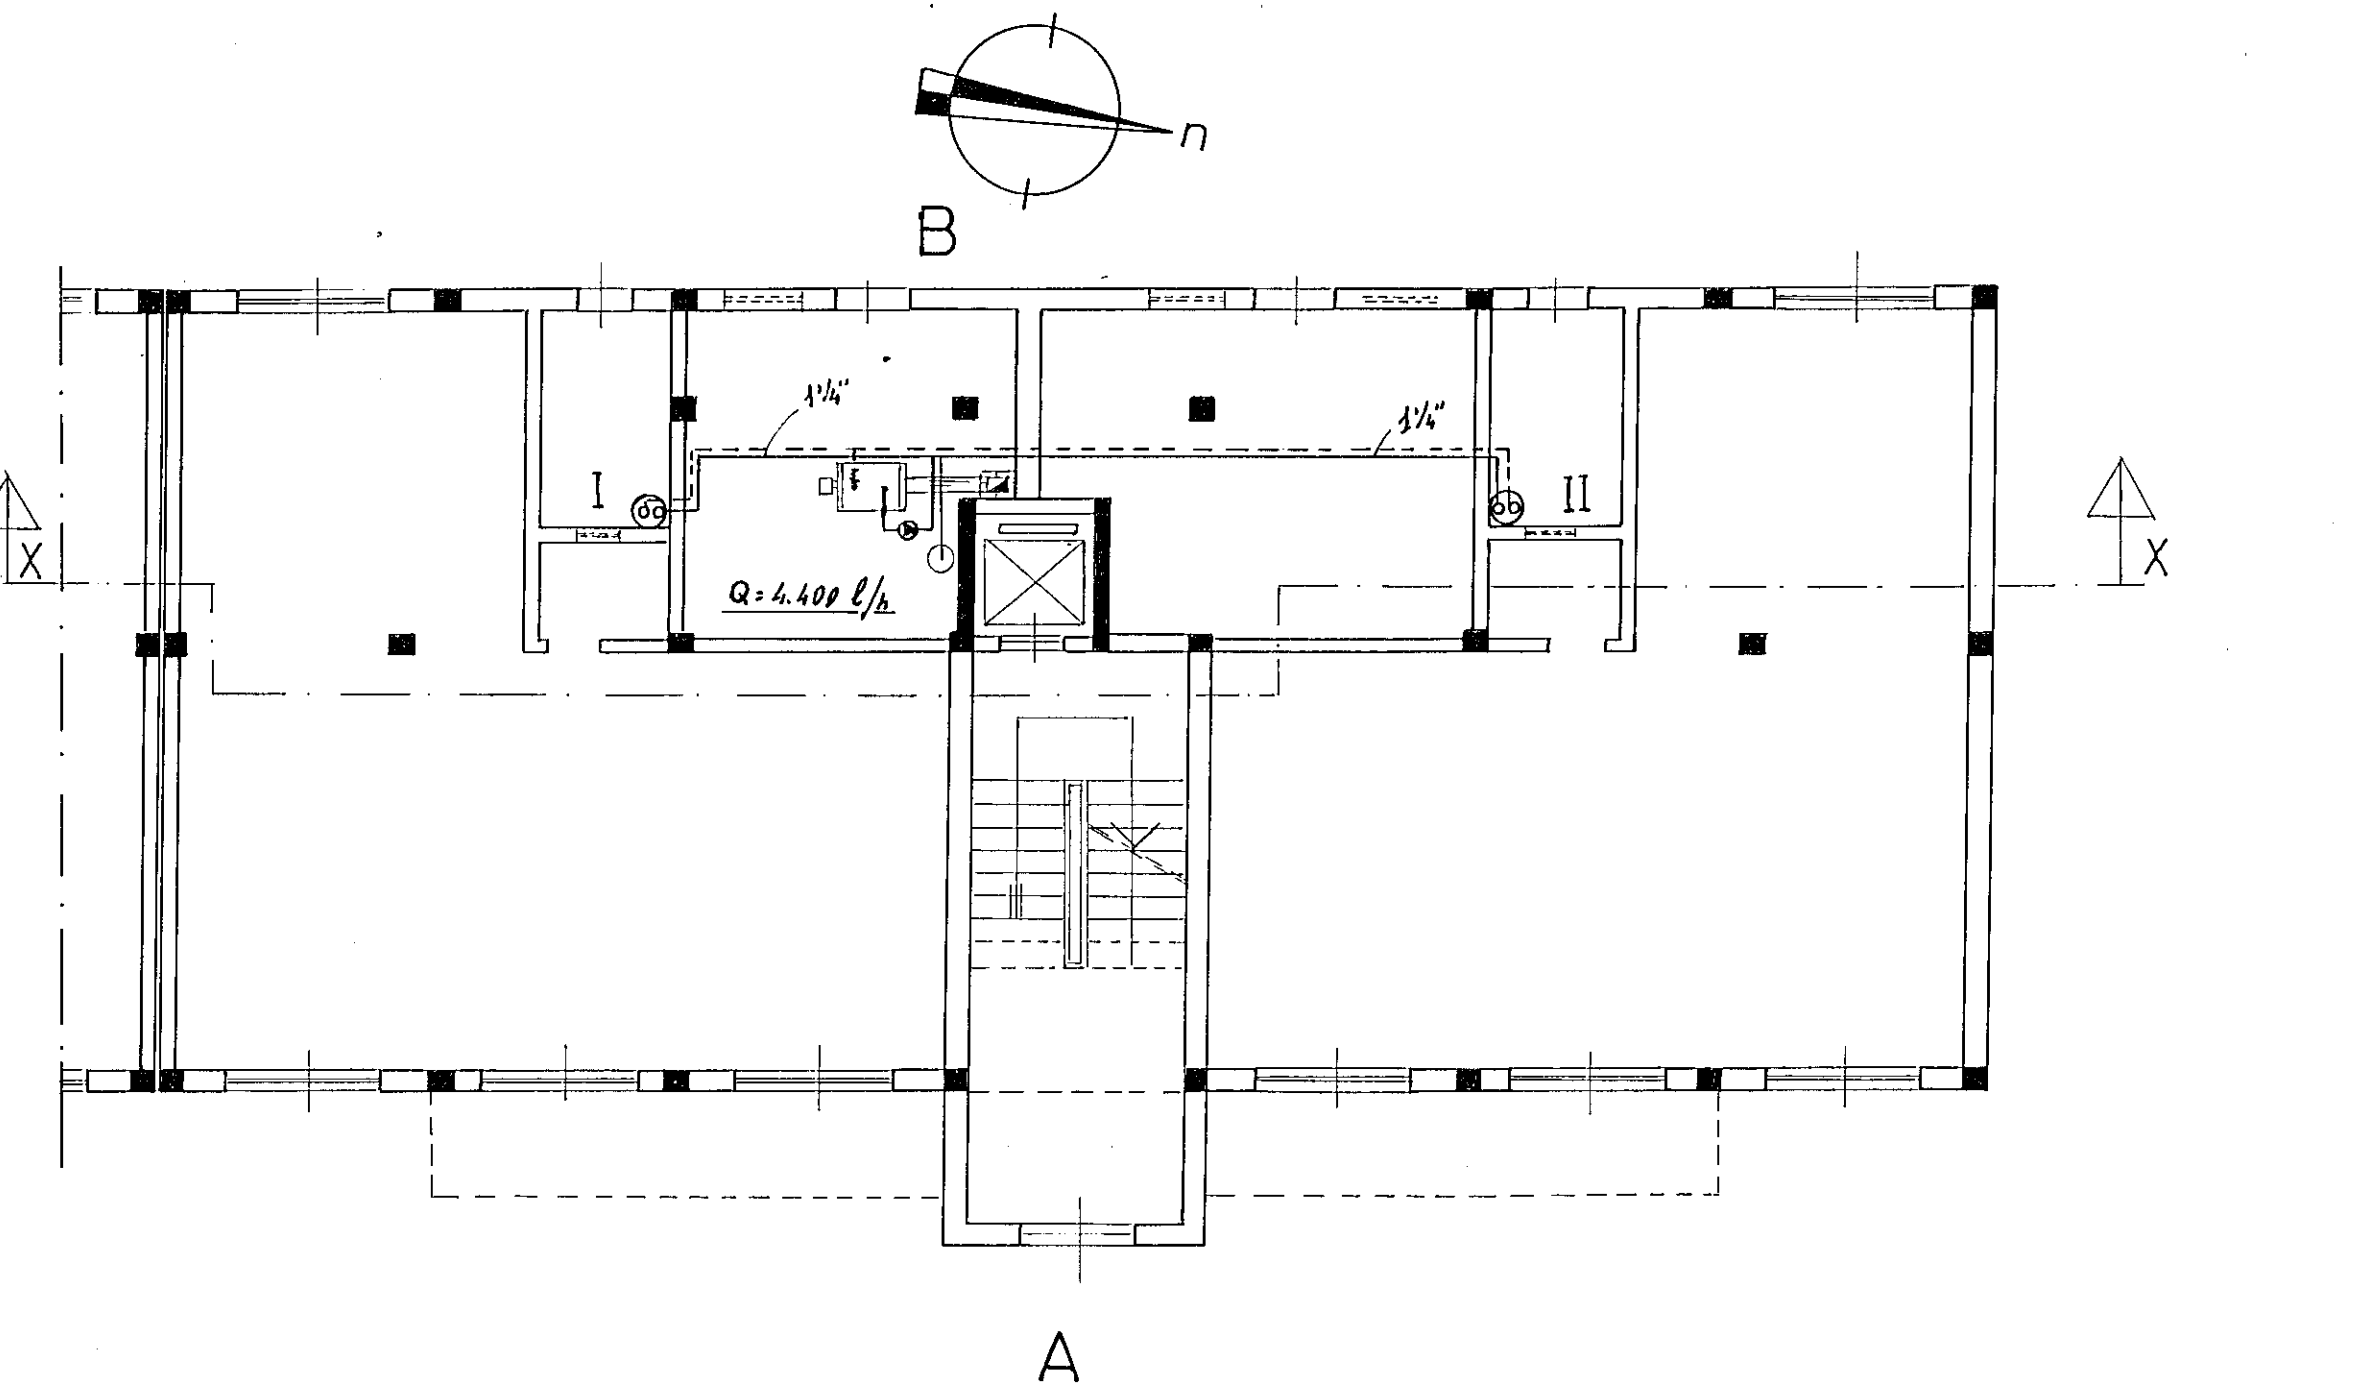

PIANO TERRA

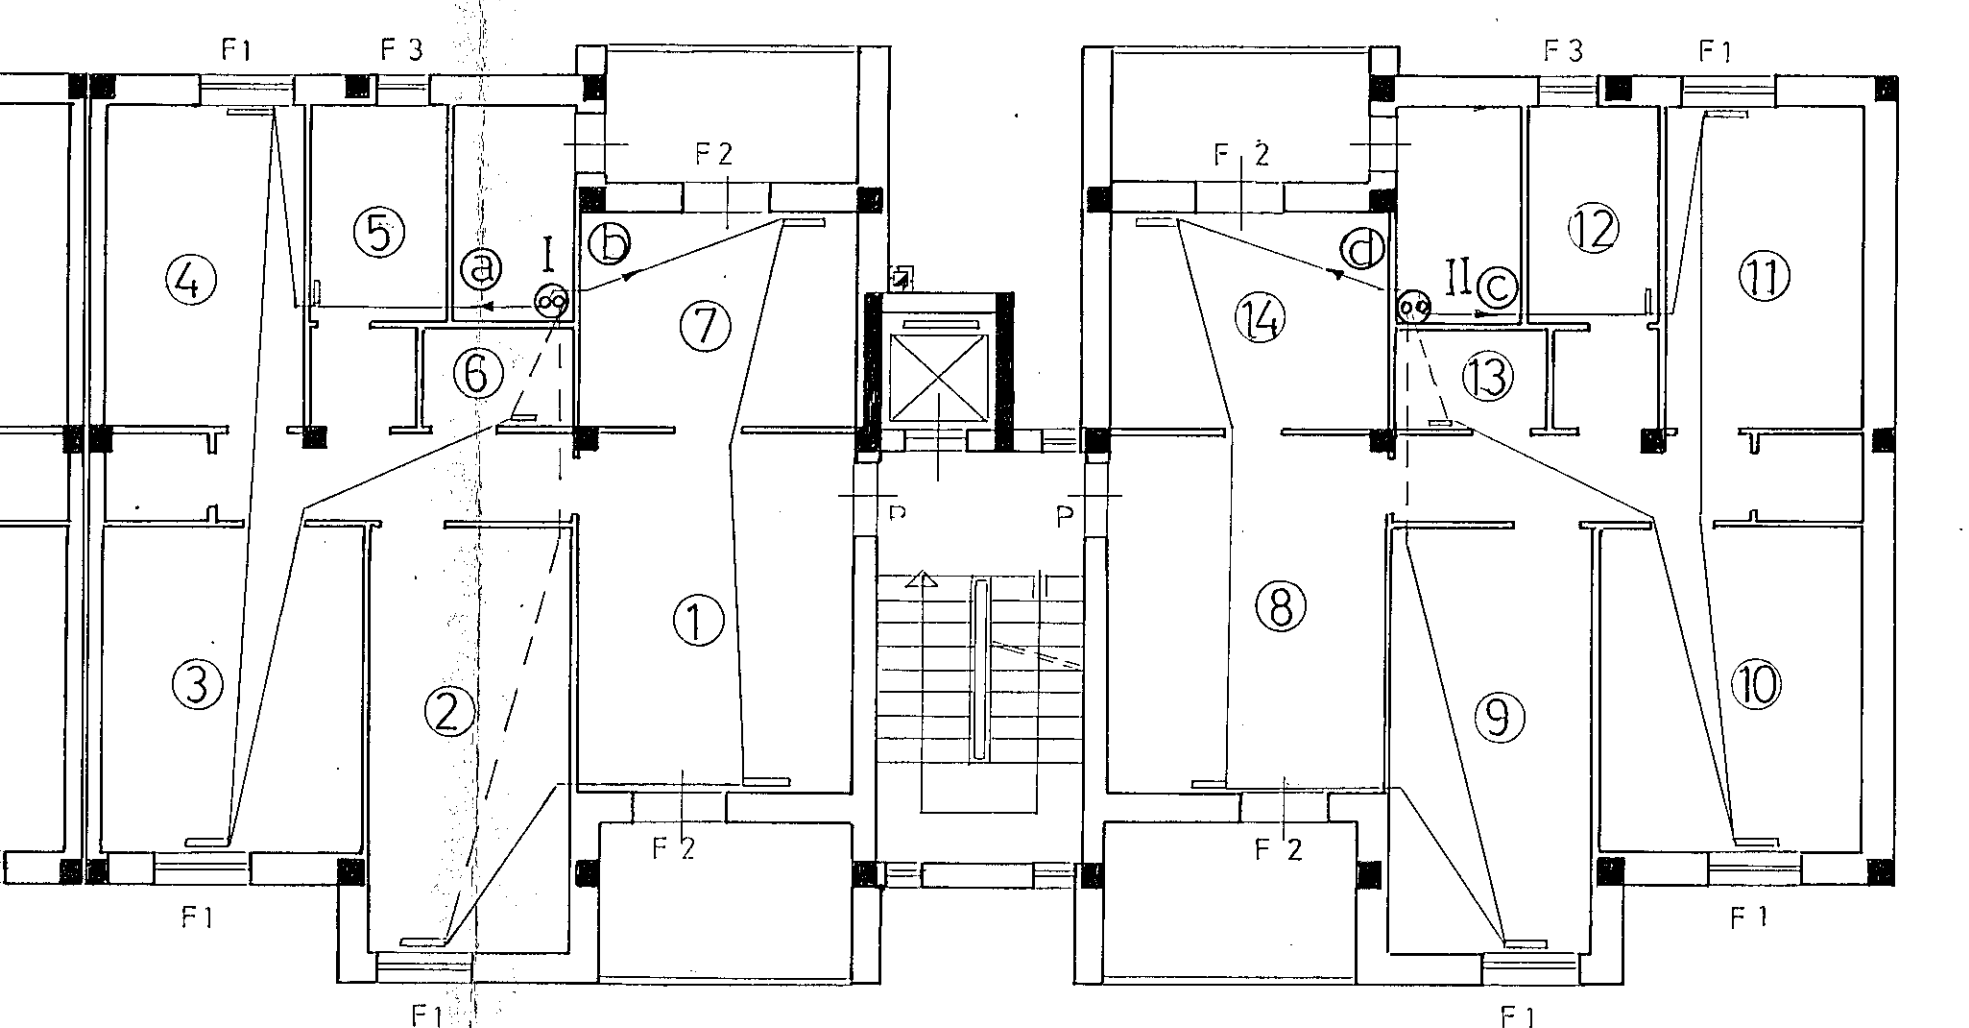

PIANO TIPO

TABELLA DEI RADIATORI

N.	P. 1°	P. 2°-3°	P. 4°
1	7 - 4 - 890	5 - 4 - 890	6 - 4 - 890
2	6 - 4 - 700	4 - 4 - 700	6 - 4 - 700
3	6 - 4 - 700	4 - 4 - 700	5 - 4 - 700
4	5 - 4 - 700	4 - 4 - 700	5 - 4 - 700
5	4 - 4 - 890	3 - 4 - 890	4 - 4 - 890
6	2 - 2 - 700	2 - 2 - 700	2 - 2 - 700
7	5 - 4 - 890	5 - 4 - 890	6 - 4 - 890
8	7 - 4 - 890	5 - 4 - 890	6 - 4 - 890
9	6 - 4 - 700	4 - 4 - 700	6 - 4 - 700
10	7 - 4 - 700	6 - 4 - 700	7 - 4 - 700
11	6 - 4 - 700	5 - 4 - 700	6 - 4 - 700
12	4 - 4 - 890	3 - 4 - 890	4 - 4 - 890
13	2 - 2 - 700	2 - 2 - 700	2 - 2 - 700
14	6 - 4 - 890	5 - 4 - 890	6 - 4 - 890


DIAMETRO TUBI ANELLI

	P. 1°	P. 2°-3°	P. 4°
a	14	12	14
b	14	14	14
c	14	14	14
d	14	14	14

Spessore coppelle TEL

Colonne montab. mm.	Rele orizzont. mm.	Centrale termica mm.
3/4"	15	For diametri tri. sinod. 2"
1"	15	15
1 1/4"	15	30
1 1/2"	15	30


SCHEMA VERTICALE

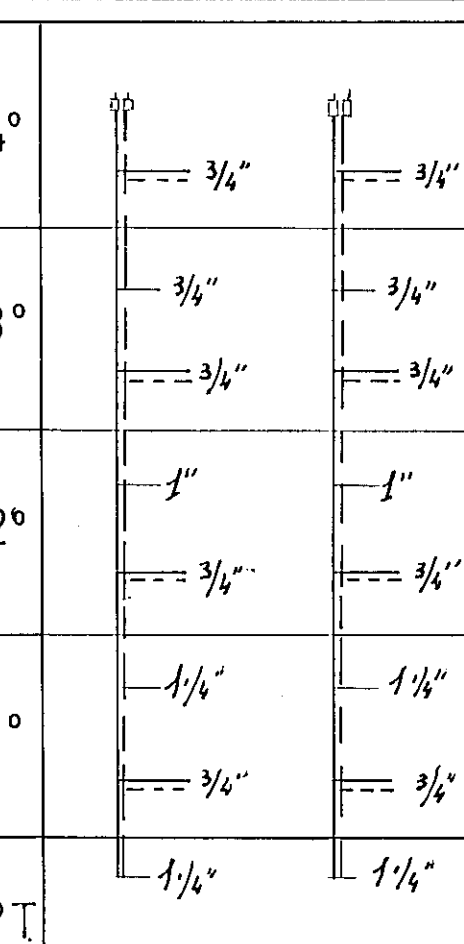

PROSPETTO A



PROSPETTO B

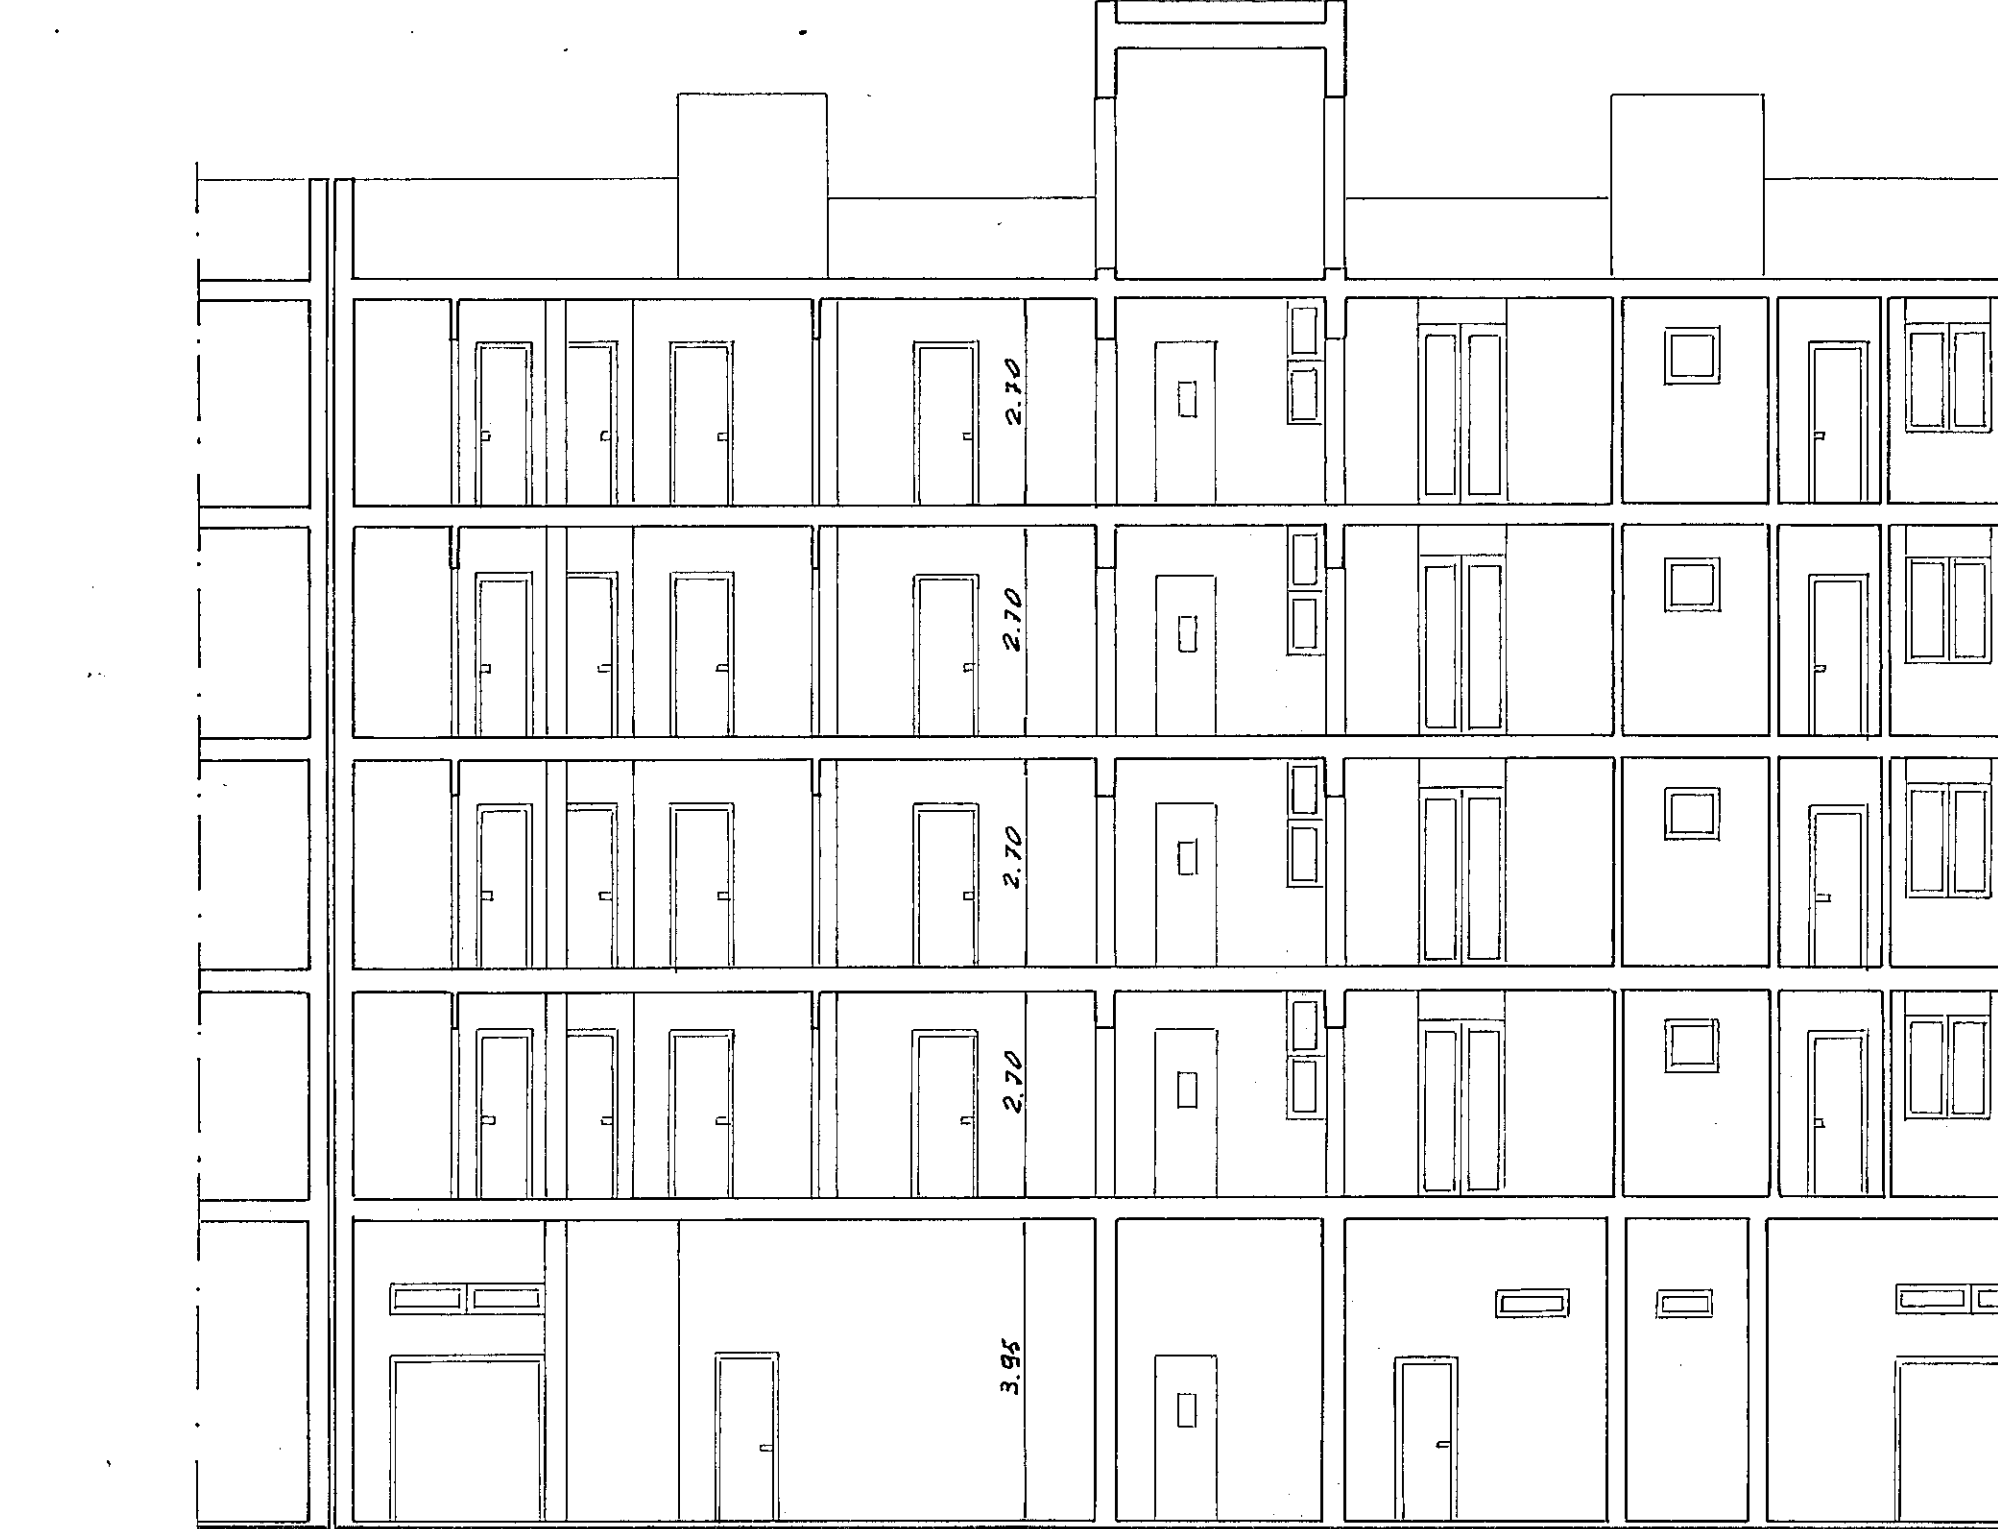

SEZIONE X-X